


PLAN

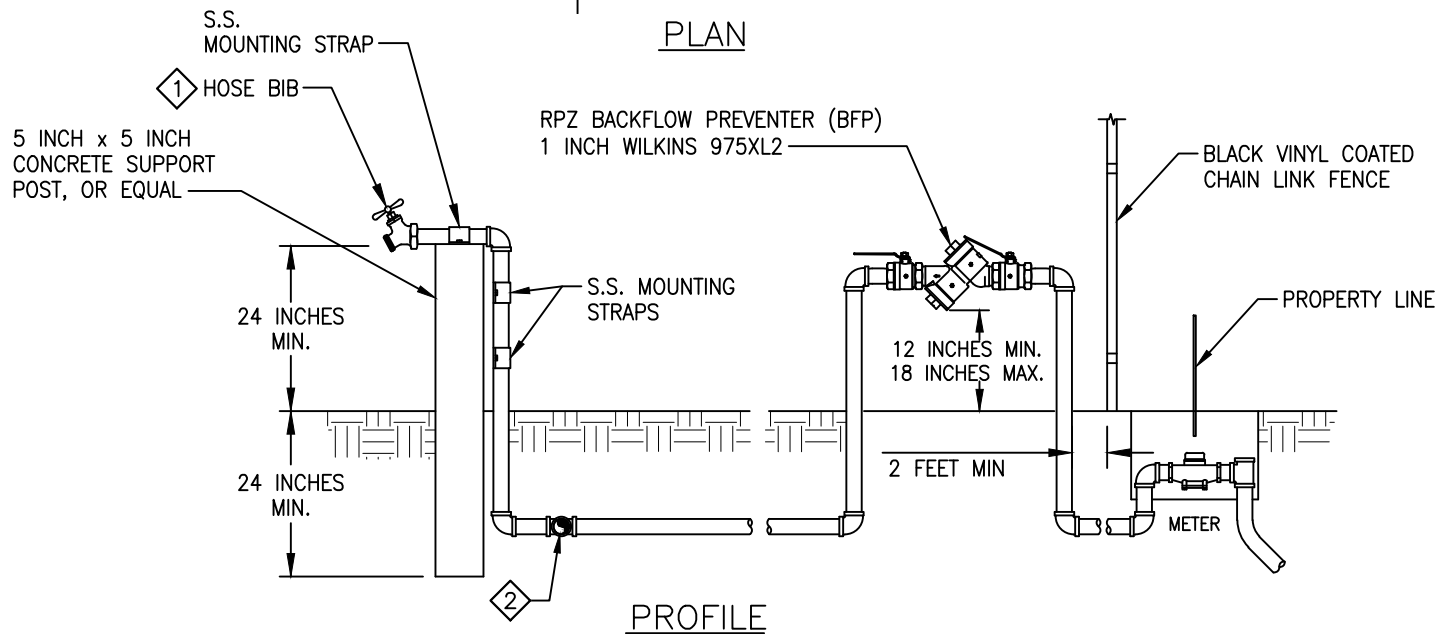

PROFILE

GENERAL NOTES:

1. REDUCED PRESSURE BACKFLOW PREVENTER (BFP) SHALL BE ON THE INSIDE OF THE FENCE.
2. NONE OF THE SERVICE LINE TO THE METER SHALL BE UNDER THE DRIVEWAY OR ANY OTHER OBSTRUCTION.

KEY NOTES:

1. HOSE BIB SHALL EXTEND PAST SUPPORT POST. EXACT LOCATION OF HOSE BIB SHALL BE APPROVED BY SARASOTA COUNTY PUBLIC UTILITIES.
2. SERVICE LINE SHALL HAVE A 1 INCH TEE FOR STILLING WELL SERVICE.

N.T.S.

TRIPLEX_DWG_NO:13.DWG



ISSUED	FEB. 2026	LAST UPDATED:
Revision	By	Appd.
		YY.MM.DD
		JANUARY 2025

LIFT STATION, METER & BFP LOCATION

TRIPLEX DWG NO. 13