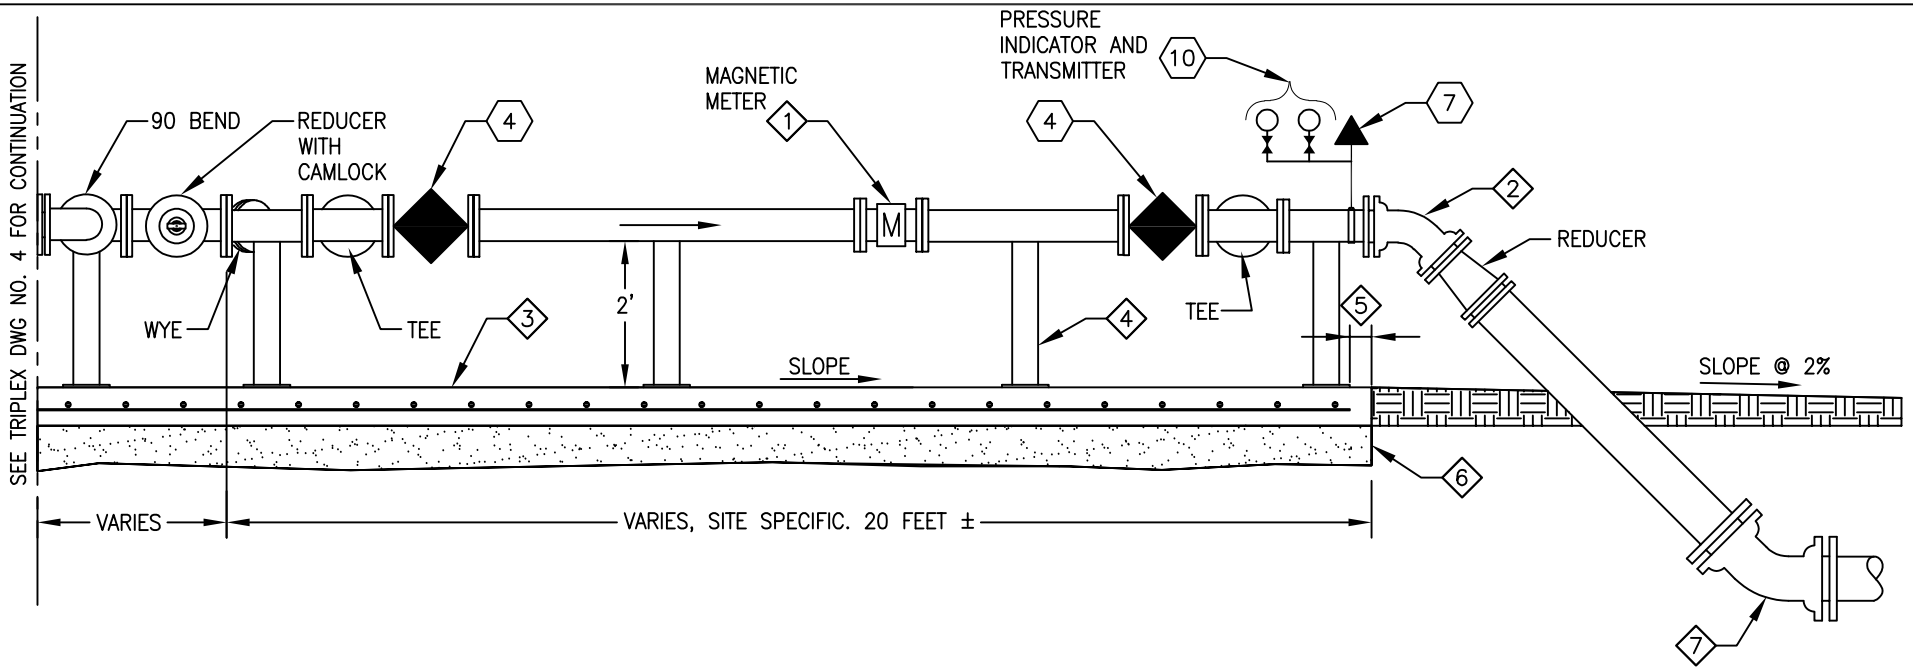

(#) REFER TO TRIPLEX DWG NO. 6

GENERAL NOTES:

1. PAINT COLOR – GREEN, TNEMEC 09SF SPEARMINT GREEN/SAFETY.
2. PRIMER COAT WITH 2 COATS OF EPOXY FOR ALL ABOVE GROUND APPURTENANCES ABOVE 3 INCHES, METER ASSEMBLIES, VALVES, AND FORCE MAIN ABOVE GROUND.

(#) KEY NOTES:

1. MAGNETIC METER SUPPLIED BY SARASOTA COUNTY PUBLIC UTILITIES AT DEVELOPER'S EXPENSE.
2. 45 BEND ABOVE GROUND FITTING ALL FLANGED, RESTRAINED JOINT.
3. 6 INCH THICK CONCRETE PAD. SLOPE TO DRAIN 1/4 INCH/FT AWAY FROM WET WELL. #4 REBAR AT 12 INCHES ON CENTER EACH WAY.
4. PIPE SUPPORTS SHALL BE 2 INCH DIAMETER ADJUSTABLE 316 S.S. STANCHION SADDLE SUPPORT AND "U" WITH MINIMUM (2) 316 S.S. NUTS ON EACH PIPE SUPPORT AND WITH 0.25 INCH NEOPRENE PADDING BETWEEN EACH SADDLE AND PIPE. PIPE SUPPORTS SHALL BE SECURED TO CONCRETE PAD.
5. PIPE SUPPORTS SHALL BE PLACED A MINIMUM 6 INCHES FROM THE EDGE OF CONCRETE PAD TO EDGE OF STAND PIPE EDGE.
6. 6 INCH MIN, COMPACTED #57 STONE BASE.
7. 45 BEND BELOW GROUND FITTING ALL MJ, RESTRAINED JOINT.

N.T.S.

TRIPLEX_DWG_NO-5.DWG

Sarasota County	ISSUED FEB. 2026 Revision By Appd. YY.MM.DD	LAST UPDATED: JANUARY 2025	LIFT STATION SECTION B-B	TRIPLEX DWG NO. 5