




**6" DEDICATED AIR TERMINAL - ELEVATION (PREFERRED)**  
 (DRY BULB TEMPERATURE 32° F OR LOWER)  
 N.T.S. STANDARD DETAIL NO. AT-3H

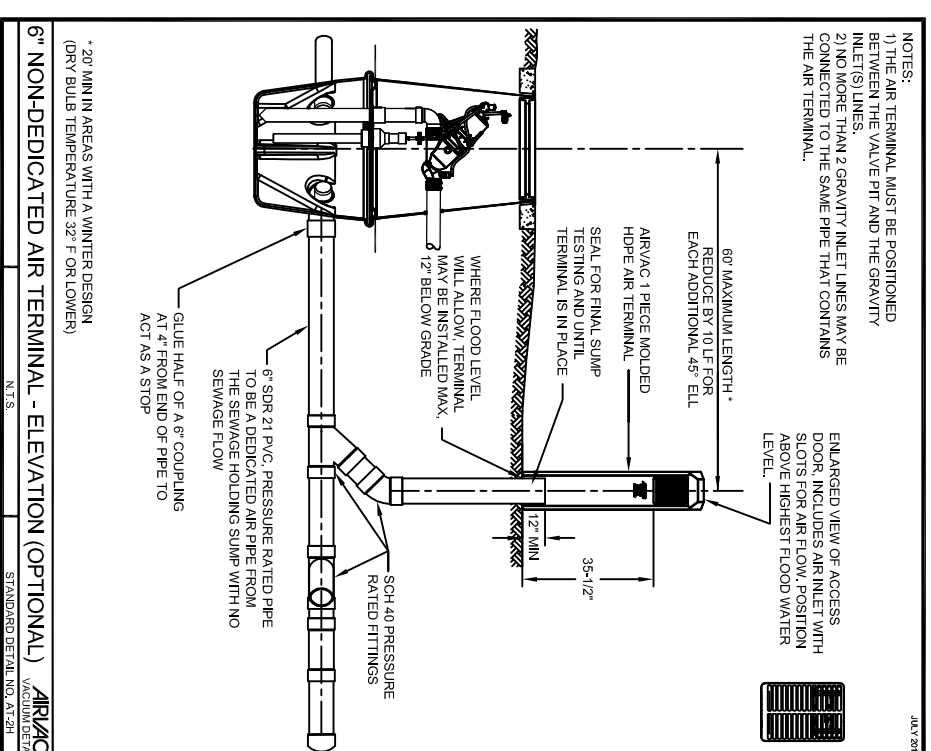


**6" NON-DEDICATED AIR TERMINAL - ELEVATION (OPTIONAL)**  
 (DRY BULB TEMPERATURE 32° F OR LOWER)  
 N.T.S. STANDARD DETAIL NO. AT-3H

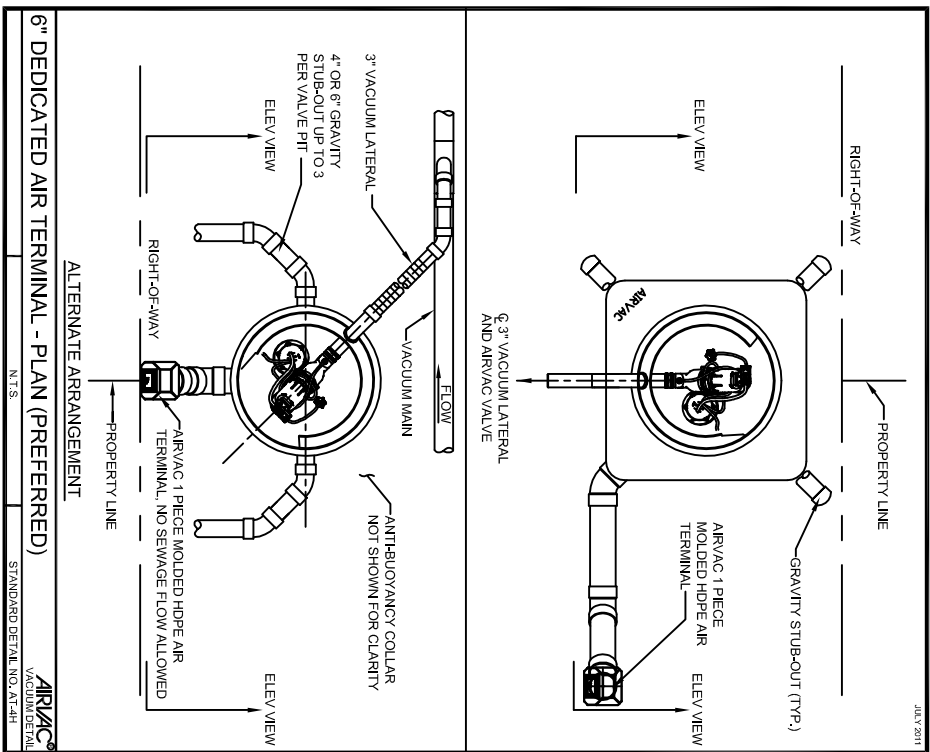

**6" DEDICATED AIR TERMINAL - PLAN (PREFERRED)**  
 N.T.S. STANDARD DETAIL NO. AT-3H

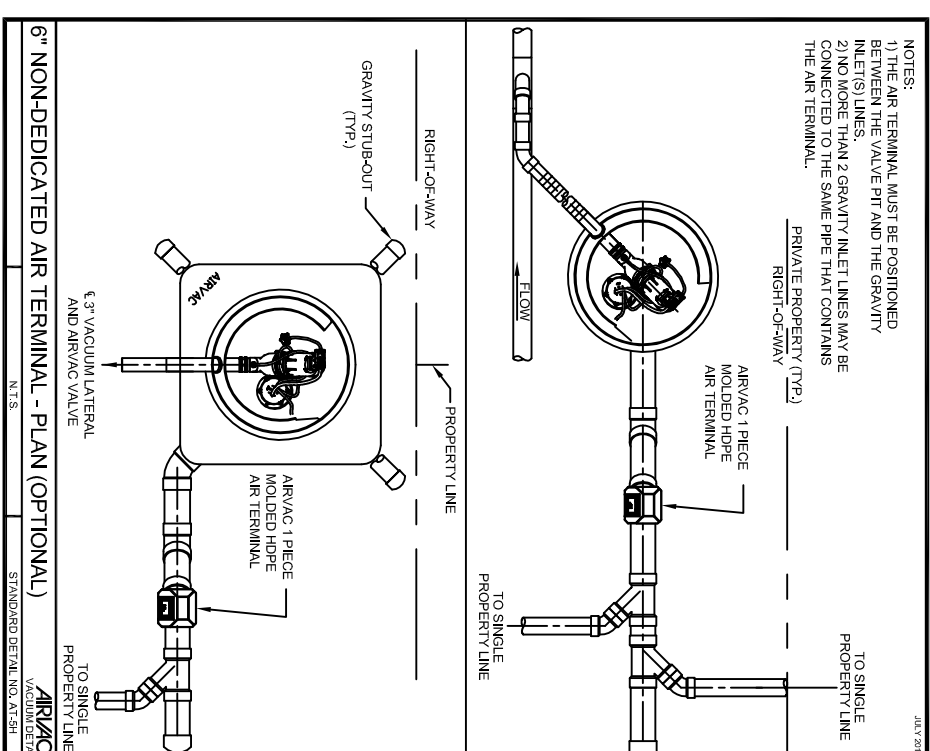

**6" NON-DEDICATED AIR TERMINAL - PLAN (OPTIONAL)**  
 N.T.S. STANDARD DETAIL NO. AT-3H

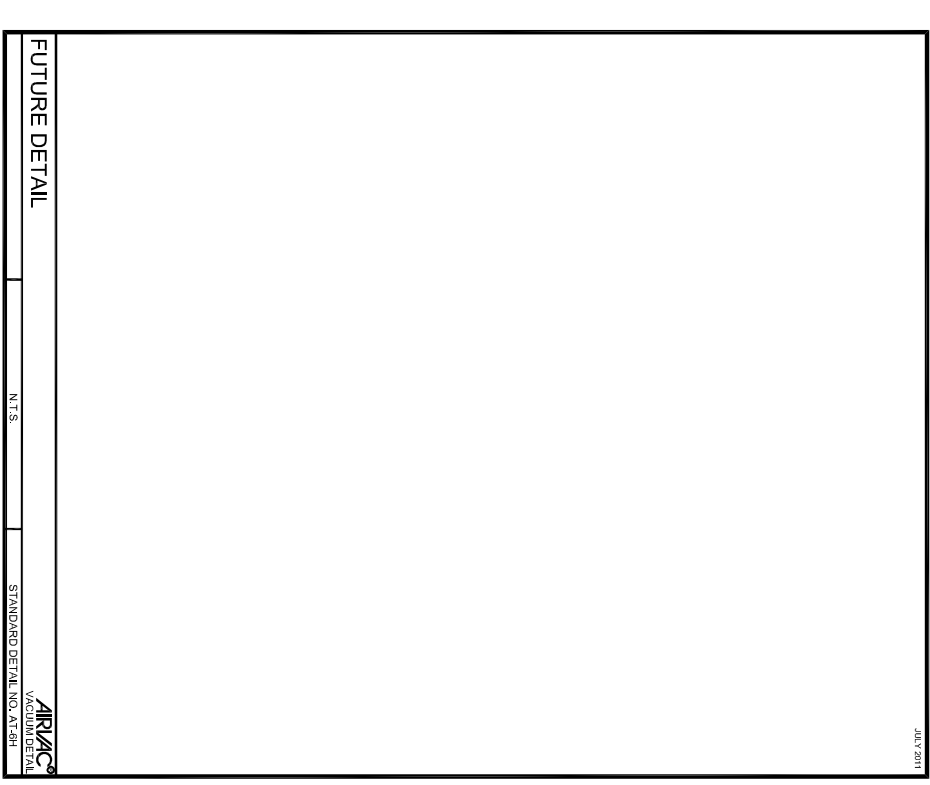

**FUTURE DETAIL**  
 N.T.S. STANDARD DETAIL NO. AT-3H

IN CONSIGNATION OF THE RECEIPT OF THIS DOCUMENT, THE USER AGREES TO HOLD AIR/VAC, INC. HARMLESS FROM AND TO REPAIR OR REPLACE ANY DAMAGE TO THE PROPERTY CAUSED BY THE INSTALLATION, MAINTENANCE, OR REMOVAL OF THE AIR TERMINAL. THE INFORMATION CONTAINED HEREIN IS FOR INFORMATION ONLY AND DOES NOT CONSTITUTE AN OFFER OF INSURANCE. SUCH ACTION BY OTHER, FOR ANY PURPOSE EXCEPT WITH THE WRITTEN PERMISSION OF AIR/VAC, INC. AND FURTHER AGREES TO SURRENDER SAME TO AIR/VAC, INC. UPON DEMAND.

NO.	REVISIONS

DATE	TITLE

**AIR-TERMINAL DETAILS - 2 PIECE VALVE PITS**