


# ITEM TO BE SUPPLIED BY SARASOTA COUNTY

(AT DEVELOPER'S EXPENSE)

- (A) 2 INCH FLANGED WATER METER LAYING LENGTH = 17 INCHES (WITHOUT GASKETS)  
TOTAL LAY LENGTH = 17-1/4 INCHES (WITH GASKETS)

# ITEMS TO BE SUPPLIED BY CONTRACTOR

- (B) 2 INCH METER SPUDS  
(C) 2 INCH FLANGED COUPLER ADAPTER KIT  
(D) CONCRETE PAD 4 INCH THICK, MINIMUM 44 INCH x 14 INCH NO REINFORCEMENT WIRE REQUIRED  
(E) 2-1/2 INCH MIP x 2 INCH FIP BUSHING  
(F) 2 INCH x 2 INCH C x FIP ADAPTER  
(G) APPROVED RESILIENT SEAT LOCKABLE BALL VALVE  
(H) HARD COPPER ASSEMBLY  
(J) 6 INCH PHOENIX VALVE BOX (WATER)  
(K) 6 INCH DIA. P.V.C. PIPE  
(L) PVC OR BUTYL INSULATION BETWEEN COPPER PIPE AND CONCRETE PAD  
(M) 4 INCH DIA. BOLLARDS

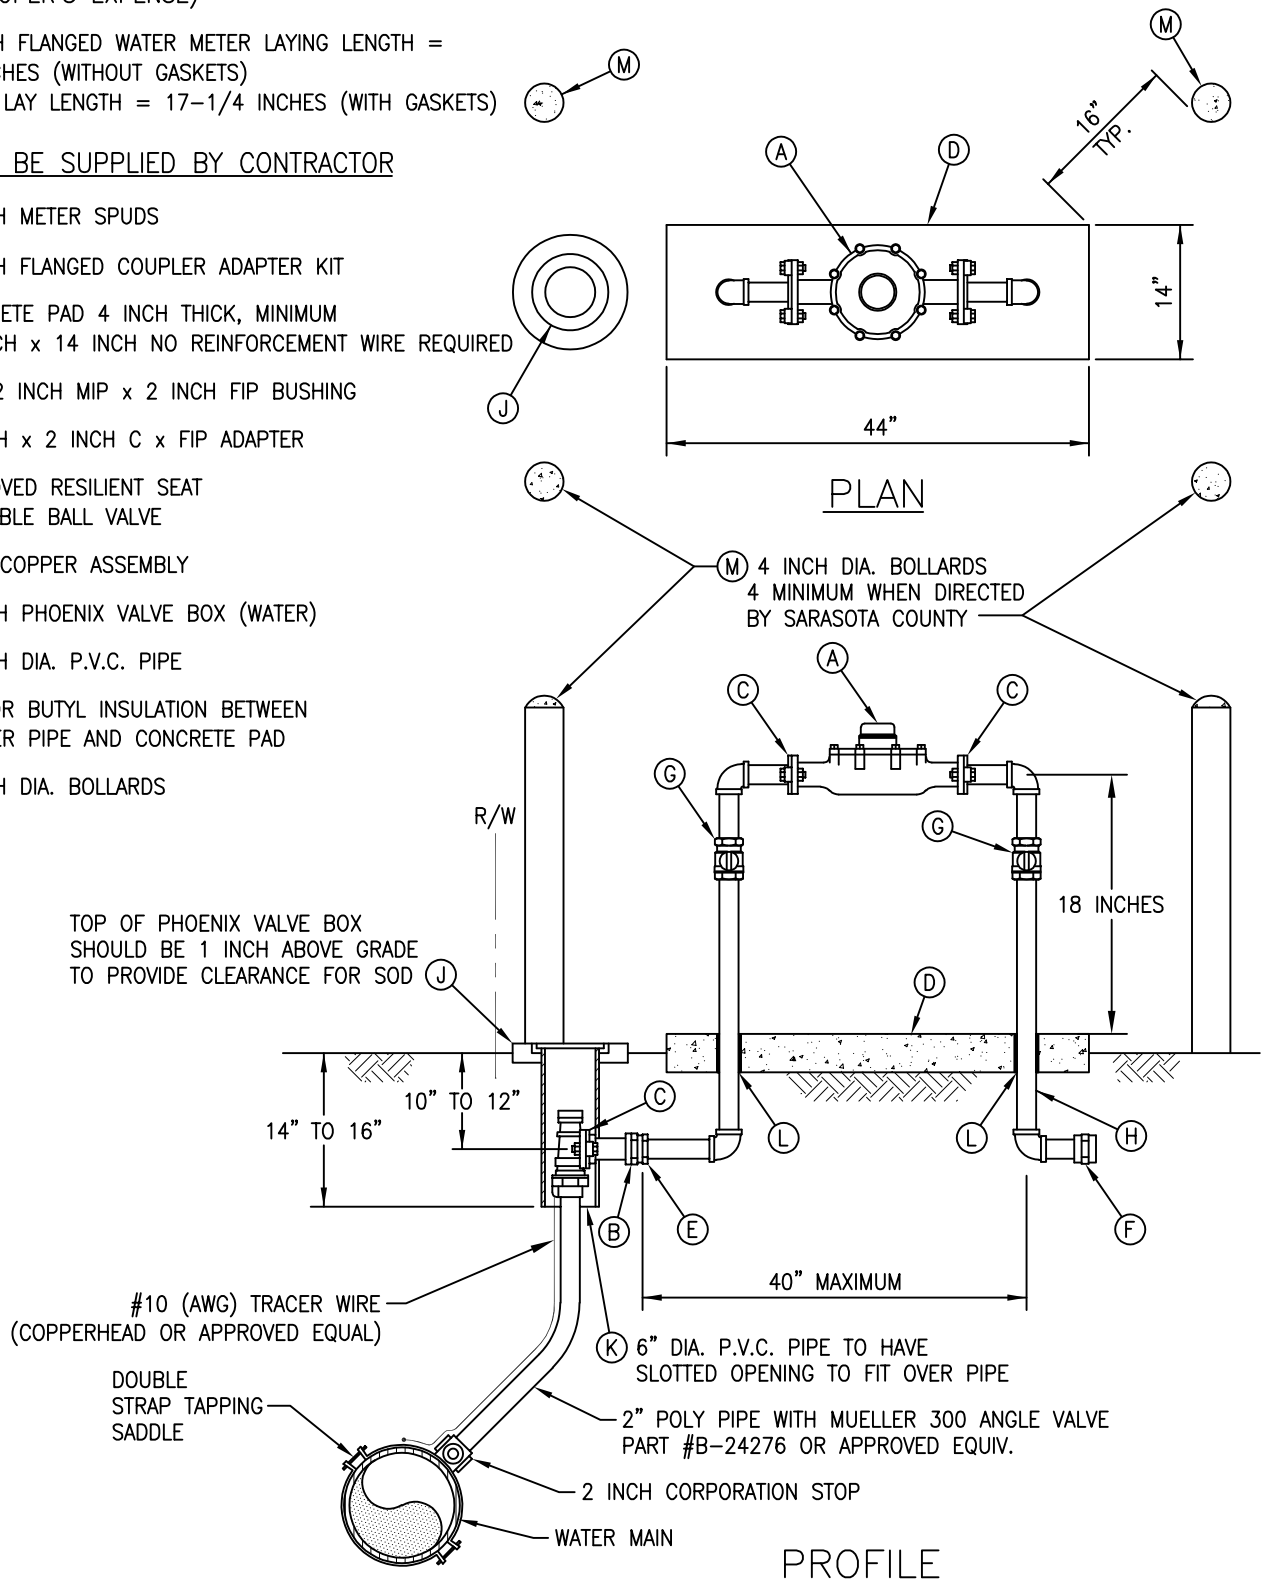

## NOTES:

1. PRIMER COAT WITH 2 COATS OF EPOXY FOR ALL ABOVE GROUND APPURTENANCES ABOVE 3 INCHES; FIRE HYDRANTS, METER ASSEMBLIES, VALVES, FORCE MAIN ABOVE GROUND ASSEMBLIES, RECLAIM ASSEMBLIES AND BRIDGE PIPE CROSSINGS.

## PROFILE

N.T.S.



Sarasota County

ISSUED NOV. 2023

ISSUED JM MMM 6-29-21  
Revision By Appd. YY.MM.DD

2 INCH COPPER METER ASSEMBLY  
(WITH METER COUPLINGS)

WATER DWG NO. 12